


DAVID Y. IGE  
GOVERNOR



HAKIM OUANSAFI  
EXECUTIVE DIRECTOR


**STATE OF HAWAII**  
DEPARTMENT OF HUMAN SERVICES  
HAWAII PUBLIC HOUSING AUTHORITY  
1002 NORTH SCHOOL STREET  
POST OFFICE BOX 17907  
Honolulu, Hawaii 96817

BARBARA E. ARASHIRO  
EXECUTIVE ASSISTANT

IN REPLY PLEASE REFER TO:  
20:CPO/169

May 26, 2020

TO: Interested Parties

FROM: Rick T. Sogawa   
Procurement Officer

SUBJECT: Invitation for Bids No. CMB-2020-26, Addendum No. 2  
Furnish Preventive Maintenance Services to the Sewage Treatment Plant  
at Kupuna Home O Waialua Under Asset Management Project 49 on  
Oahu

This Addendum No. 2 is to: 1) provide additional responses to questions that were received at the Pre-Bid Tele-Conference conducted by the Hawaii Public Housing Authority (HPHA) on May 14, 2020, up until May 18, 2020; and 2) amend the IFB to include an Attachment 16 – Photographs:

**Part I – Written Questions and Responses:**

1. What spare parts are on hand? Mainly looking at the Ebara pumps.

**Response:**

There are no spare parts on hand.

2. What are the required permit fee's?

**Response:**

There are no required permit fees.

3. What is the emergency generator intended to power? Scope points out 3 phase and single phase loads in plant.

**Response:**

The emergency generator supplies power only to the wastewater equipment.

4. Is the Alarm system land line or cell service and is that cost on the contractor?

**Response:**

The alarm system is connected by a land line which the HPHA incurs the expense.

5. Is the Siemens Mag 5100w submersible? Location of meter is why were asking.

**Response:**

The Siemens Mag 5100w is not submersible.

6. Who responsible for trash disposal?

**Response:**


The Contractor is responsible for trash disposal.

**Part II – Additional Information:**

See Attachment 16 – Photographs


If you have any questions, please call contact Rick Sogawa, IFB Coordinator at (808) 832-6038. Thank you for your attention to this matter.



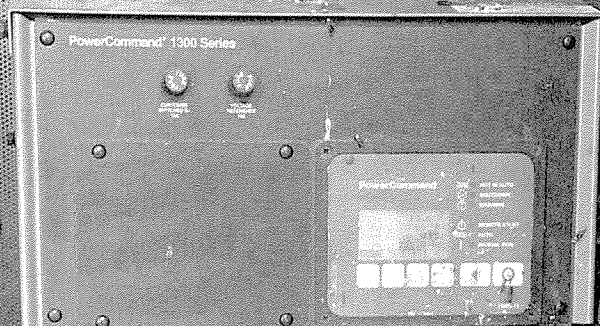

[www.cumminspower.com](http://www.cumminspower.com)




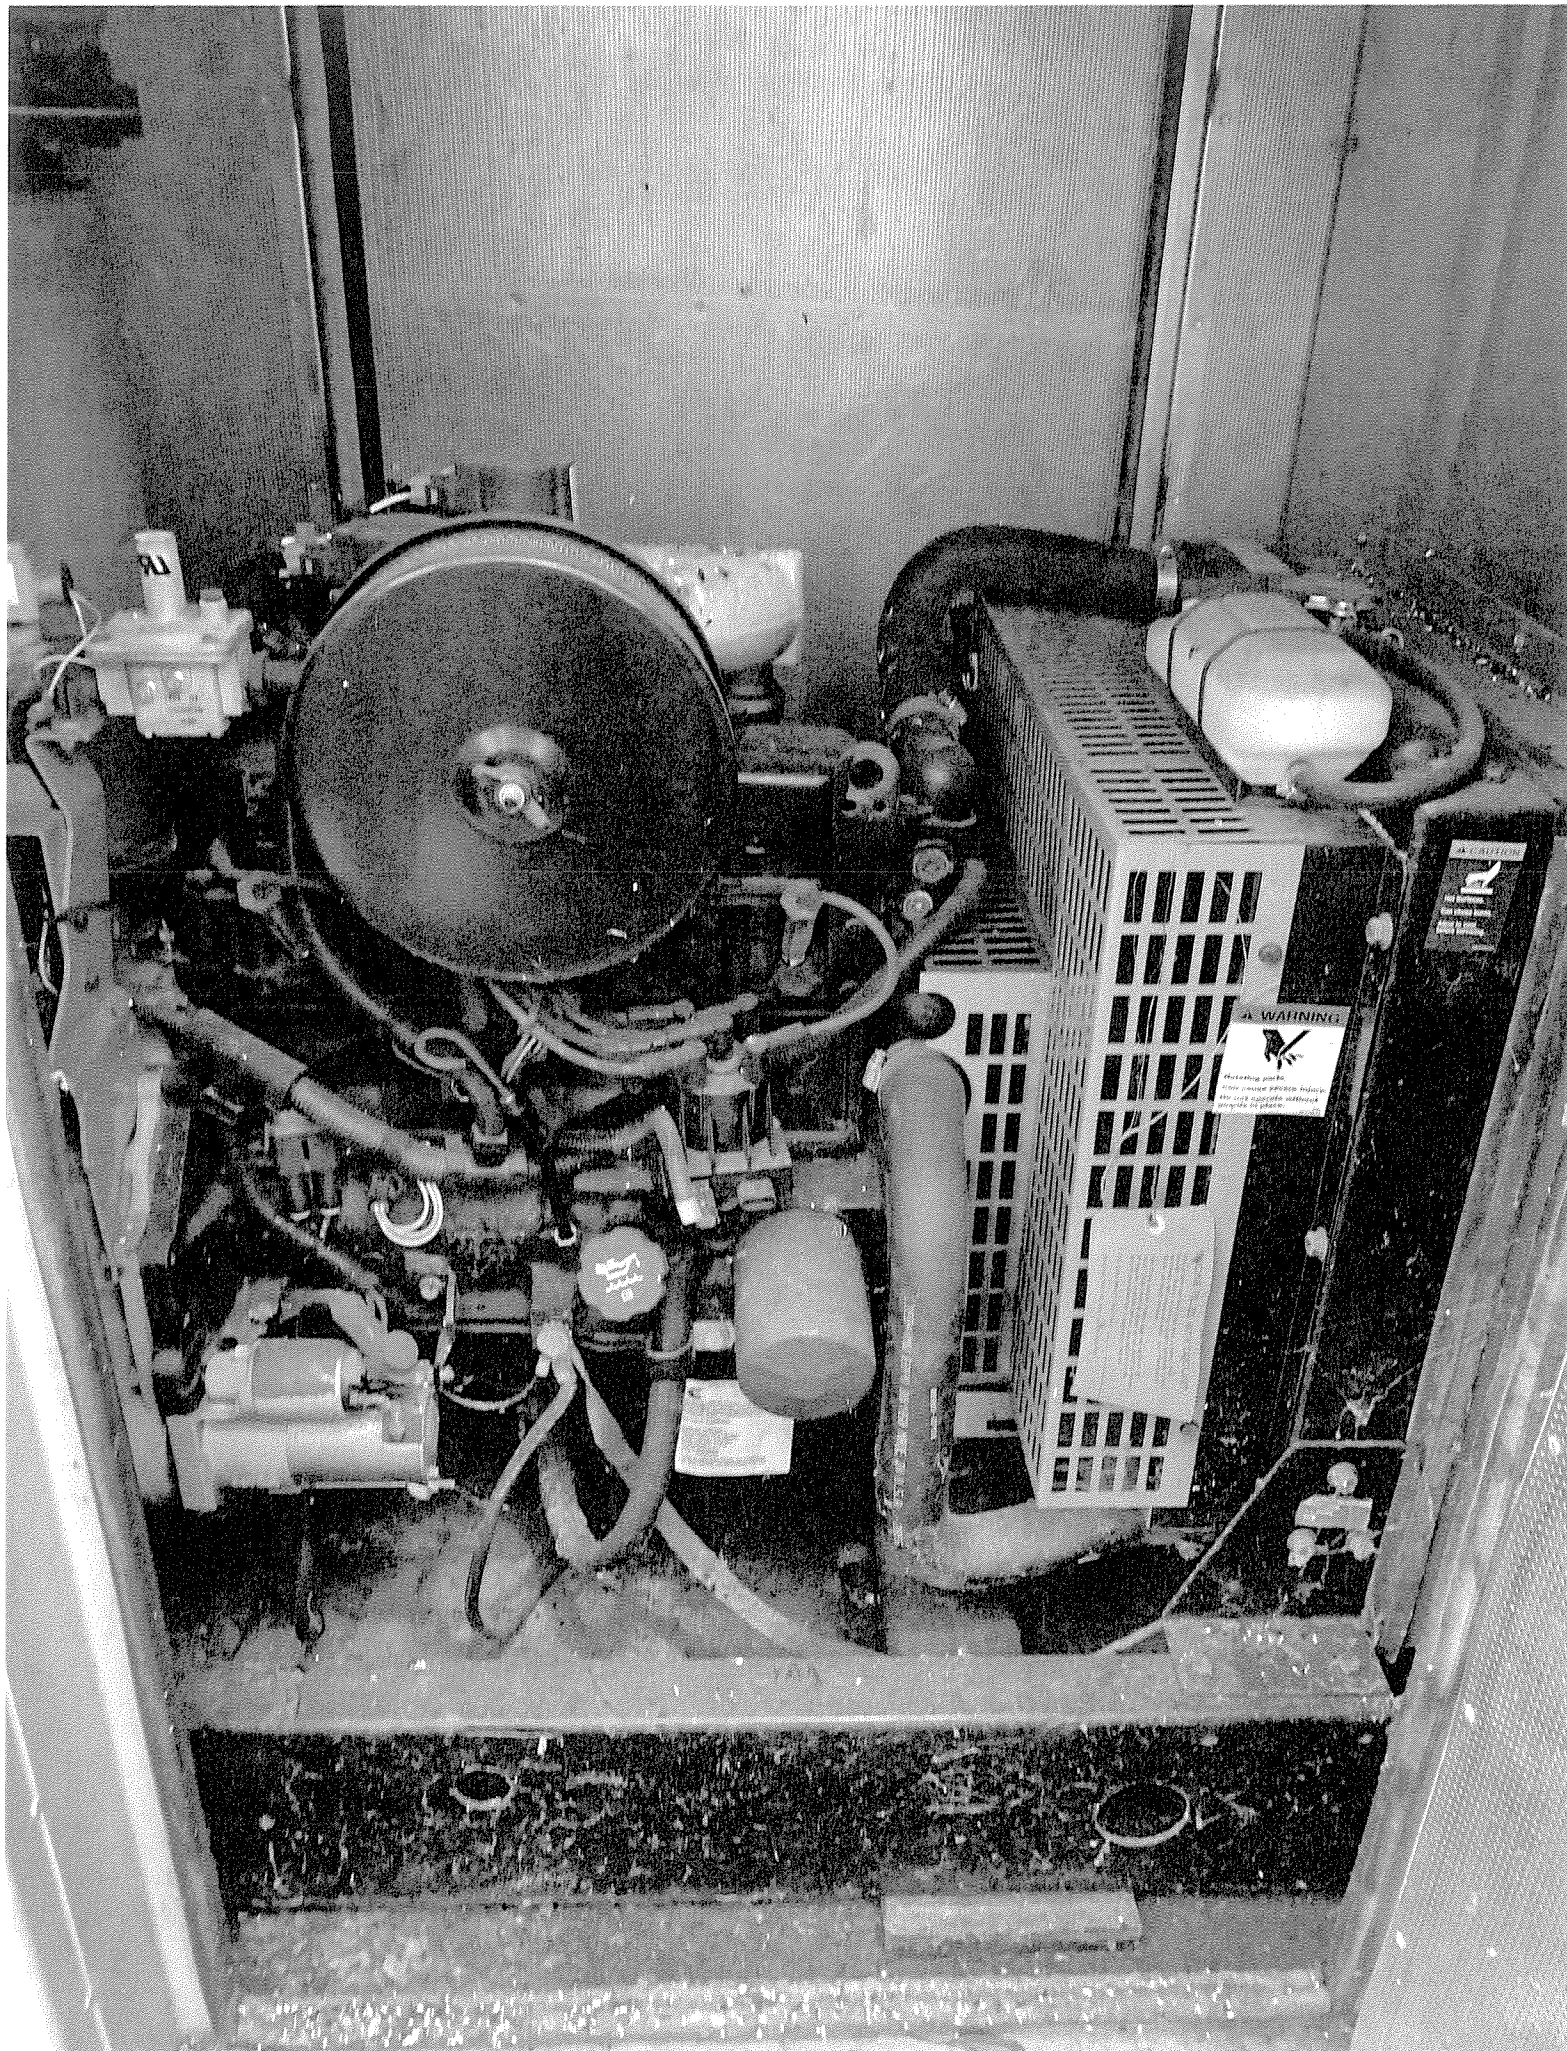







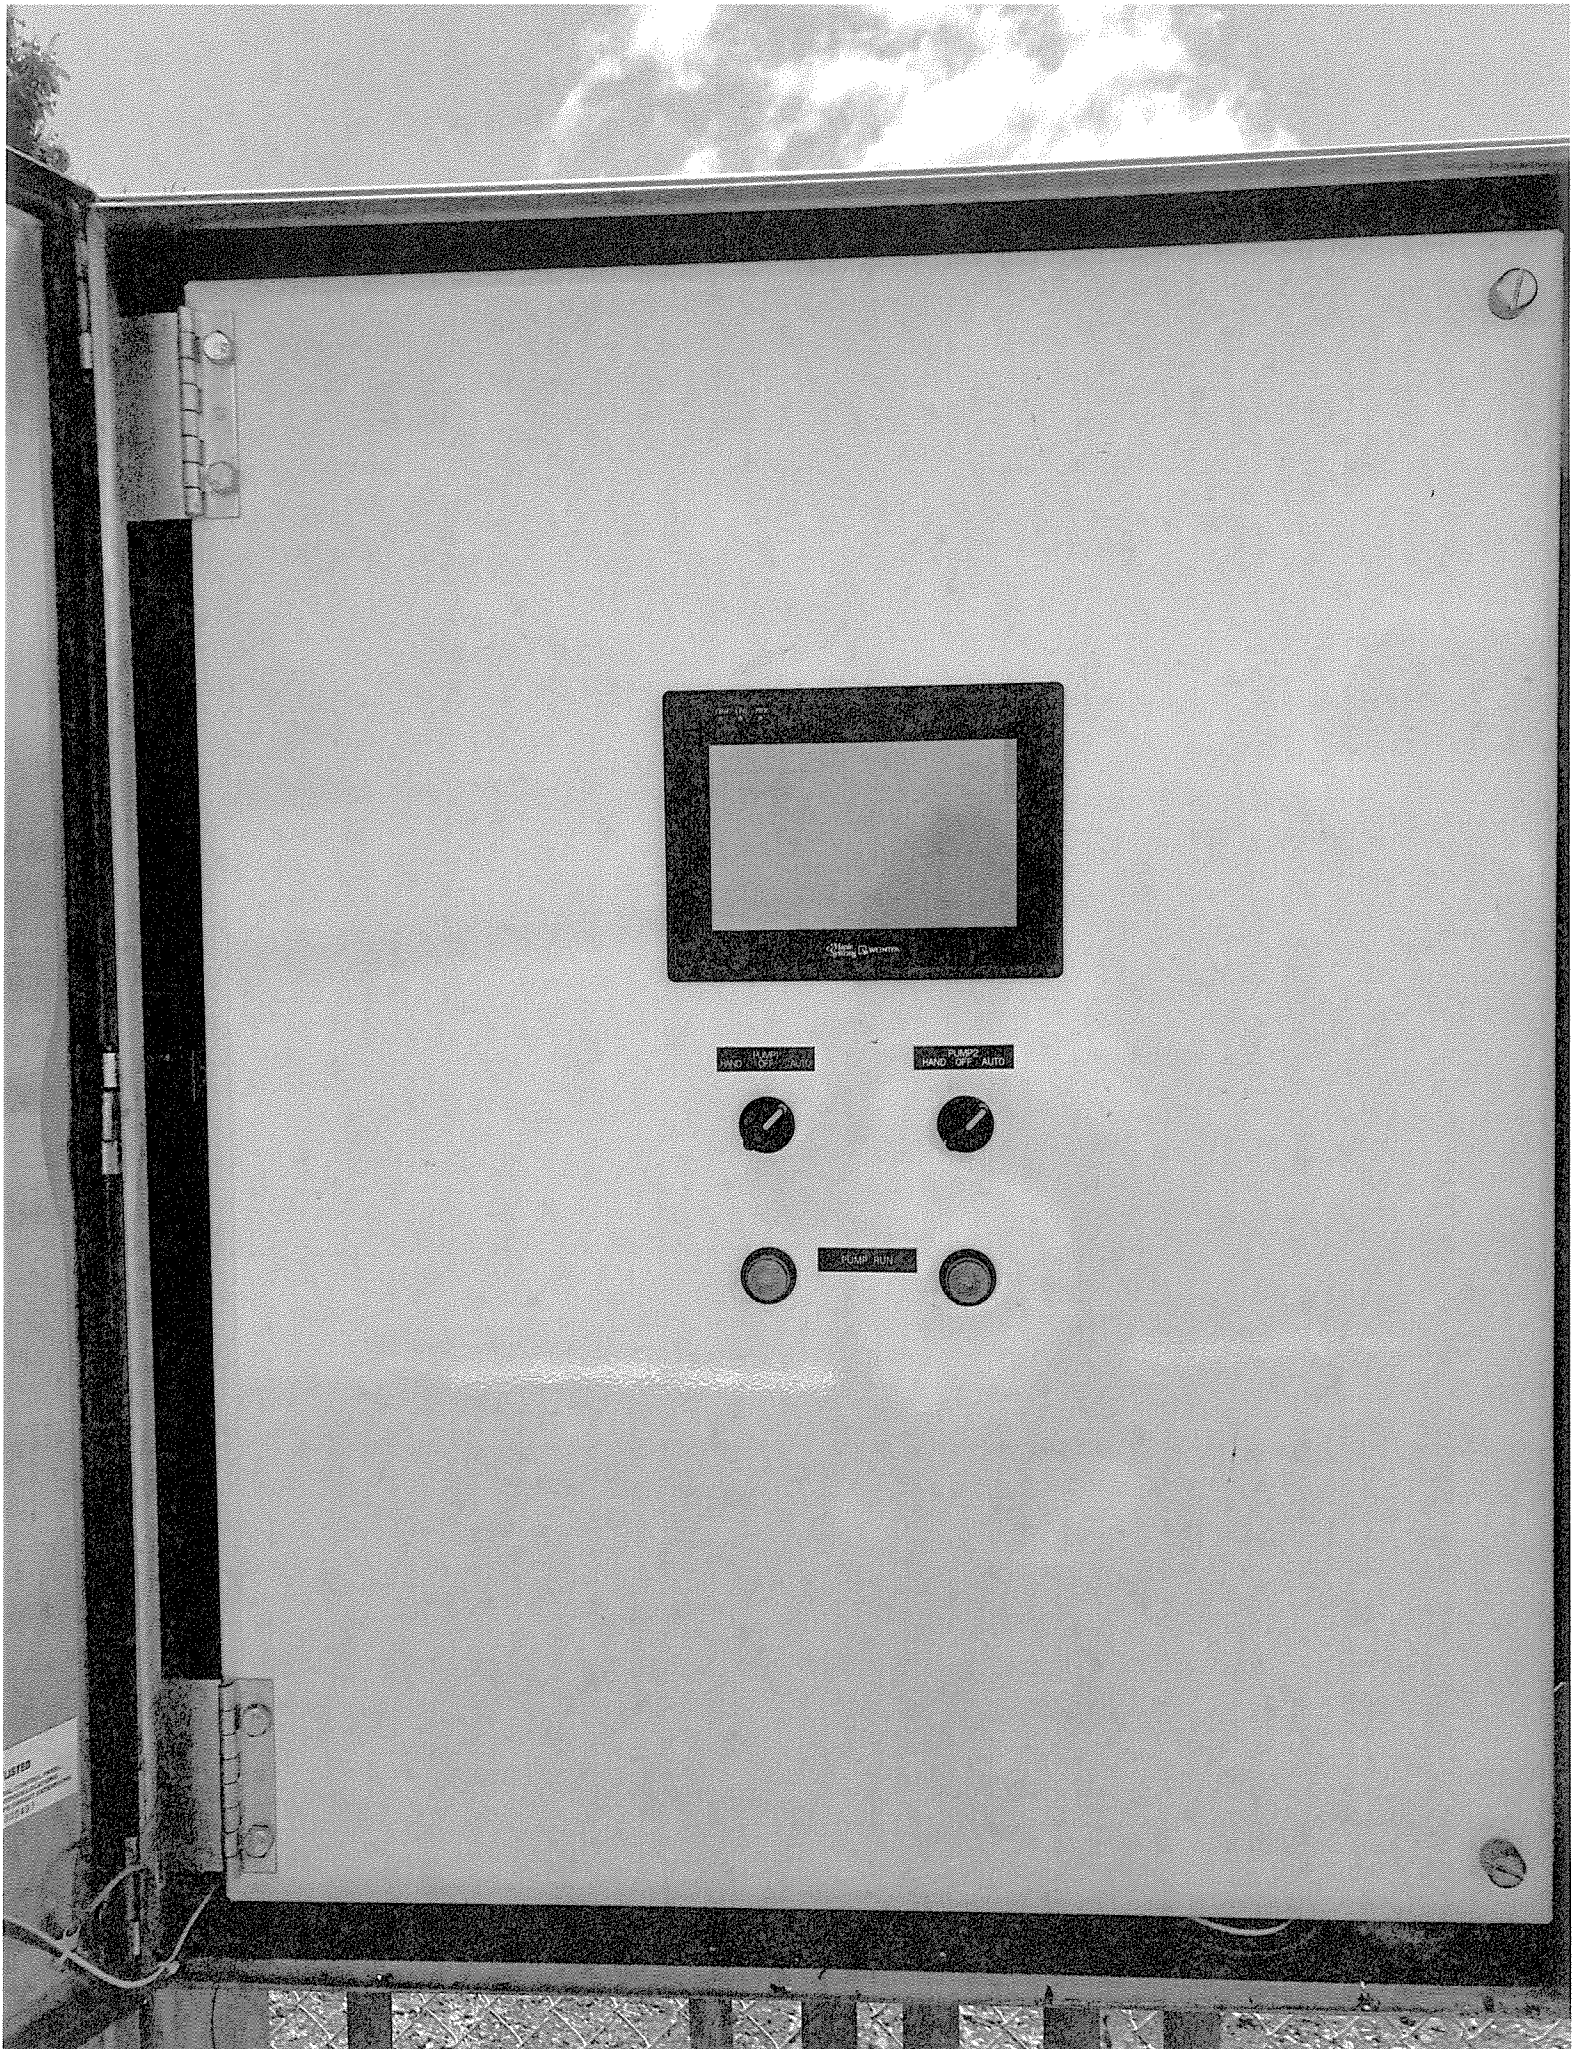










**Smith &  
Loveless, Inc.**

Lenexa, Kansas Serial No.



VFD 1 & 2




**WARNING**

Arc Flash Hazard.  
Appropriate PPE Required.  
Failure To Comply Can Result in Death or Injury.  
Refer to NFPA 70E.

INDUSTRIAL PANELS, INC. 1000 E. 10TH ST. ST. LOUIS, MO 63103



**Smith & Loveless, Inc.**

**INDUSTRIAL CONTROL PANEL  
FOR INDUSTRIAL MACHINERY**

**PERFORMANCE FACTORS**  
We will continue to provide the best  
value for money for your business.  
We are ISO 9001:2015 certified and  
have a proven track record of  
quality and service. Contact us today.

Model No.	1000-1000
Year	2010
Size	1000
Type	1000
Location	1000

**INDUSTRIAL CONTROL PANEL**  
1000-1000  
1000-1000  
1000-1000







